

CCMC 13608-R

CCMC Canadian code compliance evaluation

CCMC number:	13608-R
Status:	Active
Issue date:	2013-07-31
Modified date:	2023-11-08
Evaluation holder:	<p>Pro Post Canada Inc. 4670, Route 112 Ascot Corner QC J0B 1A0 Canada Website: www.propostfoundations.com Telephone: 844-711-7678 Email: info@propostfoundations.com</p>
Product names:	<ul style="list-style-type: none"> • 48 mm pile • 60 mm pile • 73 mm pile • 89 mm pile
Compliance:	NBC 2015, OBC
Criteria:	CCMC-TG-316615.13-15A, "CCMC Technical Guide for Augered-Installed Steel Piles"

In most jurisdictions this document is sufficient evidence for approval by Canadian authorities.

[Learn more about CCMC recognition](#) [Look for the trusted CCMC mark on products to verify compliance.](#)

Compliance opinion

It is the opinion of the Canadian Construction Materials Centre that the evaluated products, when used as an augered steel pile in a foundation system in accordance with the conditions and limitations stated in this evaluation, comply with the following code:

National Building Code of Canada 2015

Code provision	Solution type
4.2.3.8.(1)(e) CSA G40.21, "Structural Quality Steel."	<u>Acceptable</u>
4.2.3.10.(1) Where conditions are corrosive to steel, ...	<u>Acceptable</u>
4.2.4.1.(1) The design of foundations, excavations a ...	<u>Acceptable</u>
9.4.1.1.(1)(c)(i) Part 9, or	<u>Acceptable</u>

Ontario Building Code

Ruling No. 14-17-313 (13608-R) authorizing the use of this product in Ontario, subject to the terms and conditions contained in the Ruling, was made by the Minister of Municipal Affairs and Housing on 2014-10-27 pursuant to s.29 of the Building Code Act, 1992 (see Ruling for terms and conditions). This Ruling is subject to periodic revisions and updates.

The above opinion(s) is/are based on the evaluation by the CCMC of technical evidence provided by the evaluation holder, and is bound by the stated conditions and limitations. For the benefit of the user, a summary of the technical information that forms the basis of this evaluation has been included.

Product information

Product names

- 48 mm pile
- 60 mm pile
- 73 mm pile
- 89 mm pile

Product description

The product is an earth anchor constructed of helical-shaped circular steel blades that are welded to a steel shaft. The blades are constructed as a helix with a carefully controlled pitch.

Table 1. 48 mm pile physical characteristics

Outside diameter of anchor	Wall thickness of anchor	Diameter of helix blade	Thickness of helix blade
48 mm	3.7 mm	200 mm	8 mm
		250 mm	
60 mm	3.9 mm	200 mm	8 mm, 9.5 mm or 12.7 mm
		250 mm	
		300 mm	
		350 mm	
		400 mm	
		450 mm	
		500 mm	
73 mm	4.8 mm	250 mm	8 mm, 9.5 mm or 12.7 mm
		300 mm	
		350 mm	
		400 mm	
		450 mm	
		500 mm	
60 mm	4.8 mm	600 mm	8 mm, 9.5 mm or 12.7 mm
		750 mm	

This PDF is an alternative version. This document was published on 2024-02-29 and may not be the latest version of this evaluation. Users should consult the latest [published assessment](#) on the [CCMC Registry of Product Assessments](#), which contains the most up to date information. This PDF is intended for use as a record, not the latest information available.

Outside diameter of anchor	Wall thickness of anchor	Diameter of helix blade	Thickness of helix blade
89 mm	5.5 mm	250 mm	8 mm, 9.5 mm or 12.7 mm
		300 mm	
		350 mm	
		400 mm	
		450 mm	
		500 mm	
		600 mm	
		750 mm	
		900 mm	

The choice of anchor type and blade diameter is based on the bearing capacity of the soil and the load the auger-installed steel pile is designed to support. The central shaft is used to transmit torque during installation and to transfer axial loads to the helical plates. The foundation system comes with several other accessories, such as support plates (to adapt to the building structure), extension shafts and connectors.

The steel shaft, blades and accessories conform to CSA G40.21-13, "General Requirements for Rolled or Welded Structural Quality Steel/Structural Quality Steel," 330 MPa. They have a galvanic coating that meets the requirements of CAN/CSA-G164-M92 (R2003), "Hot Dip Galvanizing of Irregularly Shaped Articles," 610 g/m².

The figure below shows a typical steel pile with a single helical blade.

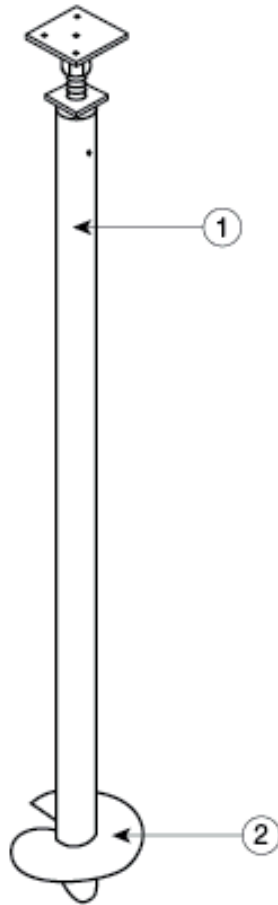


Figure 1. 48 mm pile

- 1. Shaft
- 2. Helical blade

Manufacturing plant

This evaluation is valid only for products produced at the following plant:

Product names	Manufacturing plant
	Ascot Corner, QC, CA
48 mm pile	☑
60 mm pile	☑
73 mm pile	☑
89 mm pile	☑

☑ Indicates that the product from this manufacturing facility has been evaluated by the CCMC

Conditions and limitations

The CCMC's compliance opinion is bound by this product being used in accordance with the conditions and limitations set out below.

- The product under this evaluation is intended to be used as a foundation system to support the following types of construction:
 - Single storey residential buildings within the scope of Part 9 of NBC 2015;
 - Accessory buildings such as sheds, gazebos, sunrooms, carports, and decks/porches within the scope of Part 9 of NBC 2015.

Other applications are beyond the scope of this evaluation, wherein a professional engineer skilled in such design and licensed to practice under the appropriate provincial or territorial legislation must determine the pile capacity and other design parameters.

- The product may be used as part of a foundation system to support various structures and must be installed according to the manufacturer's current instructions.
- The structural application of this product must be in strict accordance with the design analyses prepared for Pro Pieux Inc. by Labo S.M. Inc. and included in Reports No./Ref. F129038-001 and No./Ref. F1626403-001, which are dated May 2013 and March 2017, respectively.
 - The Allowable compressive and tensile loads for the proposed auger-installed pile in granular soil or silt table is reproduced from No./Ref. F129038-001, and
 - The Allowable compressive and tensile loads for the proposed auger-installed pile in cohesive soil table is reproduced from No./Ref. F1626403-001.
- When the product is installed in granular soil, silt, cohesive soil, such as clay, or in soil with granular material that does not exceed 200 mm in diameter, there is a direct relationship between the applied torque and the allowable compressive and tensile loads.
 - The Allowable compressive and tensile loads for the proposed auger-installed pile in granular soil or silt table indicates the allowable compressive and tensile loads for granular soil and silt as a function of the applied torque, and
 - The Allowable compressive and tensile loads for the proposed auger-installed pile in cohesive soil table indicates the same for cohesive soil.
- When the product is installed in a soil with granular material that exceeds 200 mm in diameter, the relationship between the applied torque and the allowable compressive and tensile loads is not as predictable. When it is installed in such soils, the allowable compressive and tensile loads must be confirmed by on-site load tests. These load tests are also required if the allowable loads are to be greater than those stated in the tables under Technical information section. The tests must be conducted under the direct supervision of a professional geotechnical engineer, skilled in such design and licensed to practise under the appropriate provincial or territorial legislation.
- In all cases, a registered professional engineer skilled in such design and licensed to practise under the appropriate provincial or territorial legislation must determine the number and spacing of the product required to carry all the loads. A certificate attesting to the conformity of the installation and the allowable loads for the product must be provided by a certified installer. Following the manufacturer's instructions, the anchors must be screwed into the ground to below the frost line using mechanized equipment. The anchor is to be rotated into the ground with sufficient applied downward pressure (crowd) to advance the anchor one pitch distance per revolution. The anchor must be advanced until the applied torque value attains a specified value. Extensions are added to the central shaft as needed. The applied loads may be tensile (uplift), or compressive (bearing). Helical

anchors are rapidly installed in a wide variety of soil formations using a variety of readily available equipment. They are immediately ready for loading after installation.

- Where conditions (soil and environmental) are determined to be corrosive to steel, protection of the steel shall be provided. The determination of the presence of corrosive conditions and the specification of the corrosion protection shall be carried out by a registered professional engineer licensed to practise under the appropriate provincial or territorial legislation. If the determination of the presence of corrosive conditions is not completed before installation, the product, including all its accessories, is required to be hot-dipped galvanized meeting the requirements of CAN/CSA-G164 (ASTM A123/A123M-17) with a minimum thickness of 610 g/m², or another method that provides an equivalent level of protection and abrasion resistance deemed acceptable by the CCMC.
- The installer of the proposed product must be certified by Pro Pieux Inc., use approved equipment, follow the manufacturer's installation instructions and respect the conditions and limitations specified in this Report. Each installer must carry a certification card bearing their signature and photograph.
- Each auger-installed steel pile must be identified with a label that contains the manufacturer's identification and the phrase "CCMC 13608-R."

Technical information

This evaluation is based on demonstrated conformance with the following criteria:

Criteria number	Criteria name
CCMC-TG-316615.13-15A	CCMC Technical Guide for Augered-Installed Steel Piles

Performance requirements

The proposed auger-installed steel piles were tested in accordance with the requirements of:

- ASTM D 1143/D 1143M-07, “Standard Test Methods for Deep Foundations Under Static Axial Compressive Load,” and
- ASTM D 3689/D 3689M-07, “Standard Test Methods for Deep Foundations Under Static Axial Tensile Load,”

Testing was conducted at four different sites. Two sites had granular soil and two sites had clay soil. A series of 30 tests was performed. The intent of the testing was to determine a correlation between the torque applied during installation and the allowable loads.

- For testing conducted in **granular and silt-based soils**, there was a good correlation between the torque applied during installation and the allowable loads; the compressive and tensile loads are noted in the Allowable compressive and tensile loads for the proposed auger-installed pile in granular soil or silt table; the factor of safety varied from 2.0 to 2.5.
- For testing conducted in **cohesive soil (such as clay)**, there was a good correlation between the torque applied during installation and the allowable loads; the compressive and tensile loads are noted in the Allowable compressive and tensile loads for the proposed auger-installed pile in cohesive soil table; the factor of safety was 2.0.
- For lateral loads in each soil condition, no correlation was possible.

Table 2. Allowable compressive and tensile loads ⁽¹⁾ for the proposed auger-installed pile in granular soil ⁽²⁾ or silt ⁽³⁾

Applied torque		Allowable load ⁽⁴⁾			
		Compression		Tension	
N·m	(lbf)	kN	(lb)	kN	(lb)
678	500	16	3 600	10	2 250
1 017	750	22	4 950	15	3 375
1 356	1 000	28	6 300	20	4 500
1 695	1 250	34	7 650	25	5 625
2 034	1 500	40	9 000	30	6 750
2 373	1 750	46	10 350	35	7 875
2 712	2 000	52	11 700	38	8 550
3 051	2 250	58	13 050	40	9 000

This PDF is an alternative version. This document was published on 2024-02-29 and may not be the latest version of this evaluation. Users should consult the latest [published assessment](#) on the [CCMC Registry of Product Assessments](#), which contains the most up to date information. This PDF is intended for use as a record, not the latest information available.

Applied torque		Allowable load ⁽⁴⁾			
		Compression		Tension	
N·m	(lbf)	kN	(lb)	kN	(lb)
3 390	2 500	64	14 400	42	9 450

Notes:

- 1 These allowable loads are only valid when the product is installed in granular soil or silt. Special attention is required when the auger-installed steel piles are installed in a recently backfilled site, where the granular material exceeds 200 mm in diameter or in cohesive soils. In these cases, this table does not apply and the allowable loads need to be determined by on-site confirmatory testing.
- 2 Granular soils (coarse-grained soil) are non-cohesive soils (e.g., sand, gravel or silt with little or no clay content and little to no cohesive strength).
- 3 Silt is that portion of soil material passing through a No. 200 (75-µm) U.S. standard sieve that is non-plastic or very slightly plastic and exhibits little or no strength when air-dried.
- 4 The load values in this table include a minimum safety factor of 2.0.

Table 3. Allowable compressive and tensile loads for the proposed auger-installed pile in cohesive soil ⁽¹⁾

Applied torque		Allowable load ⁽²⁾			
		Compression ⁽³⁾		Tension ⁽⁴⁾	
N·m	(lbf)	kN	(lb)	kN	(lb)
678	500	9	2 025	3	675
1 017	750	15	3 375	8	1 800
1 356	1 000	21	4 725	12	2 700
1 695	1 250	27	6 075	16	3 600
2 034	1 500	32	7 200	20	4 500
2 373	1 750	38	8 550	25	5 625
2 712	2 000	44	9 900	29	6 525
3 051	2 250	50	11 250	33	7 425
3 390	2 500	55	12 375	37	8 325

Notes:

-
- 1 These allowable loads are valid only when the pile is installed in a cohesive (clay) soil. Always check the nature of the soils in place before using this table.
 - 2 If the granular material exceeds 200 mm in diameter, the permissible load capacity listed above will be an overestimate. This table does not apply in such a case and the allowable loads need to be determined by on-site confirmatory testing.
 - 3 The load values in this table include a minimum safety factor of 2.0.
 - 4 The tightening torque corresponds to the average torque measured on the manometer when screwing the last 50 cm of the pile.
-

Administrative information

Use of Canadian Construction Materials Centre (CCMC) assessments

This assessment must be read in the context of the entire [CCMC Registry of Product Assessments](#), any applicable building code or by-law requirements, and/or any other regulatory requirements (for example, the [Canada Consumer Product Safety Act](#), the [Canadian Environmental Protection Act](#), etc.).

It is the responsibility of the user to confirm that the assessment they are using is current and has not been withdrawn or superseded by a later version on the [CCMC Registry of Product Assessments](#).

Disclaimer

The National Research Council of Canada (NRC) has evaluated only the characteristics of the specific product described herein. The information and opinions in this evaluation are directed to those who have the appropriate degree of experience to use and apply its contents (such as authorities having jurisdiction, design professionals and specifiers). This evaluation is valid when the product is used as part of permitted construction, respecting all conditions and limitations stated in the evaluation, and in accordance with applicable building codes and by-laws.

This evaluation is provided without representation, warranty or guarantee of any kind, expressed or implied, and the NRC provides no endorsement for any evaluated product. The NRC accepts no responsibility whatsoever arising in any way from any and all use of or reliance on the information contained herein or the use of any evaluated product. The NRC is not undertaking to render professional or other services on behalf of any person or entity nor to perform any duty owed by any person or entity to another person or entity.

Language

Une version française de ce document est disponible.

In the case of any discrepancy between the English and French version of this document, the English version shall prevail.

Copyright

© His Majesty the King in Right of Canada, as represented by the National Research Council of Canada, 2024

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording or otherwise, without the prior written permission of the CCMC.

This PDF is an alternative version. This document was published on 2024-02-29 and may not be the latest version of this evaluation. Users should consult the latest [published assessment](#) on the [CCMC Registry of Product Assessments](#), which contains the most up to date information. This PDF is intended for use as a record, not the latest information available.

CCMC recognition

The Canadian Construction Materials Centre (CCMC) assesses compliance with Canadian building, energy and safety codes. We are the only construction code compliance service supported and operated by the Government of Canada. Trusted by over 6,000 regulators across Canada.

Most Canadian authorities having jurisdiction (AHJs) consider CCMC product assessments acceptable as evidence for product approval.

CCMC assessments are recognized by construction authorities across Canada:

Alliance of Canadian Building Official Associations (ACBOA)



(Alliance of Canadian Building Official Associations (ACBOA))

First Nations National Building Officers Association (FNNBOA)



(First Nations National Building Officers Association (FNNBOA))

Canadian Home Builders' Association (CHBA)



(Canadian Home Builders' Association (CHBA))

Alberta Building Officials Association (ABOA)



(Alberta Building Officials Associations (ABOA))

Saskatchewan Building Officials Association (SBOA)



(Saskatchewan Building Officials Association (SBOA))

Manitoba Building Officials Association (MBOA)



(Manitoba Building Officials Association (MBOA))

Ontario Building Officials Association (OBOA)



(Ontario Building Officials Association (OBOA))

New Brunswick Building Officials Association (NBBOA)



(New Brunswick Building Officials Association (NBBOA))

Nova Scotia Building Officials Association (NSBOA)



(Nova Scotia Building Officials Association (NSBOA))

The CCMC provides code compliance assessments to Canadian code requirements, consulting nationwide with construction regulators to elicit regional variations in code requirements as well as provincial and local interpretations. Users are advised to review the technical information presented in CCMC assessments when making approval decisions. [Learn more about how the CCMC provides a unique service for Canada.](#)

For more information, contact the CCMC by phone at (613) 993-6189 or by email at ccmc@nrc-cnrc.gc.ca

NOTICE

The information presented on this webpage (in HTML format) is the most up-to-date information available from the CCMC about this assessment.

By downloading this PDF you acknowledge that:

- this PDF is intended for record-keeping purposes only,
- it represents the information as it was available at the time of downloading, and
- it may not reflect the latest available information at some future date.

References to this CCMC assessment (in product literature, on websites, etc.) must be made by linking to the evaluation webpage. **This PDF must not be used as a means of distributing this assessment to an audience.**

[View PDF \(Portable document format\)](#)

Code compliance as an acceptable solution

Code Compliance via Acceptable Solutions

If a building design (e.g. material, component, assembly or system) can be shown to meet all provisions of the applicable **acceptable solutions** in Division B (e.g. it complies with the applicable provisions of a referenced standard), it is deemed to have satisfied the objectives and functional statements linked to those provisions and thus to have complied with that part of the Code.

— National Building Code of Canada, Sentence A-1.2.1.1.(1)(a)

The CCMC has determined that compliance with this provision of the Code has been demonstrated as an **Acceptable Solution**. The evaluation report provides a summary of the basis of CCMC's compliance opinion.

CCMC's code compliance opinions

All CCMC evaluation reports are opinions of code compliance established in accordance with the National Building Code of Canada, Subsection 1.2.1. "Compliance with this Code," which requires compliance to be achieved by:

- complying with the applicable acceptable solutions in Division B, or
- using an alternative solution that will achieve at least the minimum level of performance required by Division B in the areas defined by the objective and functional statements attributed to the applicable acceptable solutions.

The CCMC assesses compliance with Canadian building, energy and safety codes, and is trusted by over 6,000 regulators across Canada.

Code compliance as an alternative solution

Code Compliance via Alternative Solutions

Where a design differs from the acceptable solutions in Division B, then it should be treated as an **"alternative solution."** A proponent of an alternative solution must demonstrate that the alternative solution addresses the same issues as the applicable acceptable solutions in Division B and their attributed objectives and functional statements. However, because the objectives and functional statements are entirely qualitative, demonstrating compliance with them in isolation is not possible. Therefore, Clause 1.2.1.1.(1)(b) identifies the principle that Division B establishes the quantitative performance targets that alternative solutions must meet. In many cases, these targets are not defined very precisely by the acceptable solutions [...] Nevertheless, Clause 1.2.1.1.(1)(b) makes it clear that an effort must be made to demonstrate that an alternative solution will perform as well as a design that would satisfy the applicable acceptable solutions in Division B—not “well enough” but “as well as.”

— National Building Code of Canada, Sentence A-1.2.1.1.(1)(b)

The CCMC has determined that compliance with this provision of the Code has been demonstrated as an **Alternative Solution**. The evaluation report provides a summary of the basis of CCMC's compliance opinion.

CCMC's code compliance opinions

All CCMC evaluation reports are opinions of code compliance established in accordance with the National Building Code of Canada, Subsection 1.2.1. "Compliance with this Code," which requires compliance to be achieved by:

- complying with the applicable acceptable solutions in Division B, or
- using an alternative solution that will achieve at least the minimum level of performance required by Division B in the areas defined by the objective and functional statements attributed to the applicable acceptable solutions.

The CCMC assesses compliance with Canadian building, energy and safety codes, and is trusted by over 6,000 regulators across Canada.